




Temperatures achieved in a swimming pool in Somerset by solar water heating (in the dismal summer of 2007)

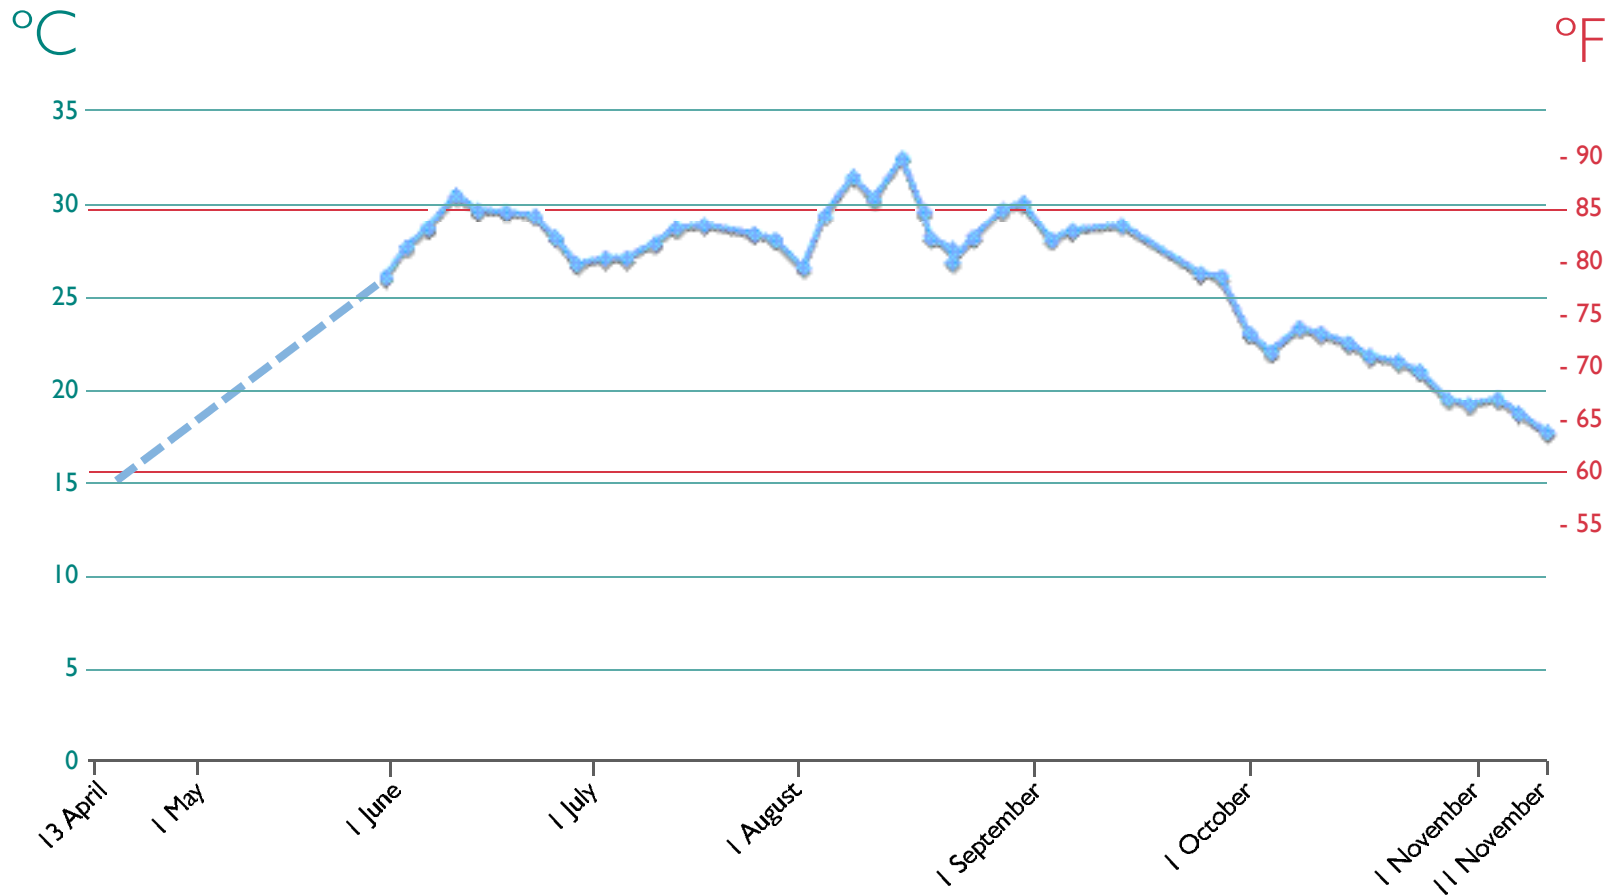

Indoor unheated pool in an outbuilding, 8 x 4 x 1.5 metres in size.

Solar heating system switched on, 13 April, when pool temperature was 15°C. No other heating available.

Pool temperature measured by client twice a week, from 31 May to 11 November 2007.

Solar heating system is 90 Navitron 47 mm evacuated tubes, installed by Soltrac Ltd.

Name and address of client supplied on request.

Soltrac Ltd
St Mary's Cottage, Wardour, Tisbury
Salisbury, Wiltshire SP3 6RE
Tel. 07506 478074 (sales), 01747 873003 (office)
Email: info@soltrac.co.uk www.soltrac.co.uk

www.soltrac.co.uk